DRAWING NOTES:

1. FOR ALL ELECTRICAL SYMBOLS AND ABBREVIATIONS SEE DRAWING E0.0.01
2. FOR PANEL SCHEDULES SEE DRAWING E6.1.01
3. EF-1 SHALL BE INTERLOCKED ELECTRICALLY WITH VENTILATOR V1 AND EF-2 INTERLOCKED WITH V2
4. EF-3 IS CONTROLLED THRU WALL MOUNTED TOGGLE SWITCH, REFER TO FLOOR PLAN ON DRAWING E2.1.01

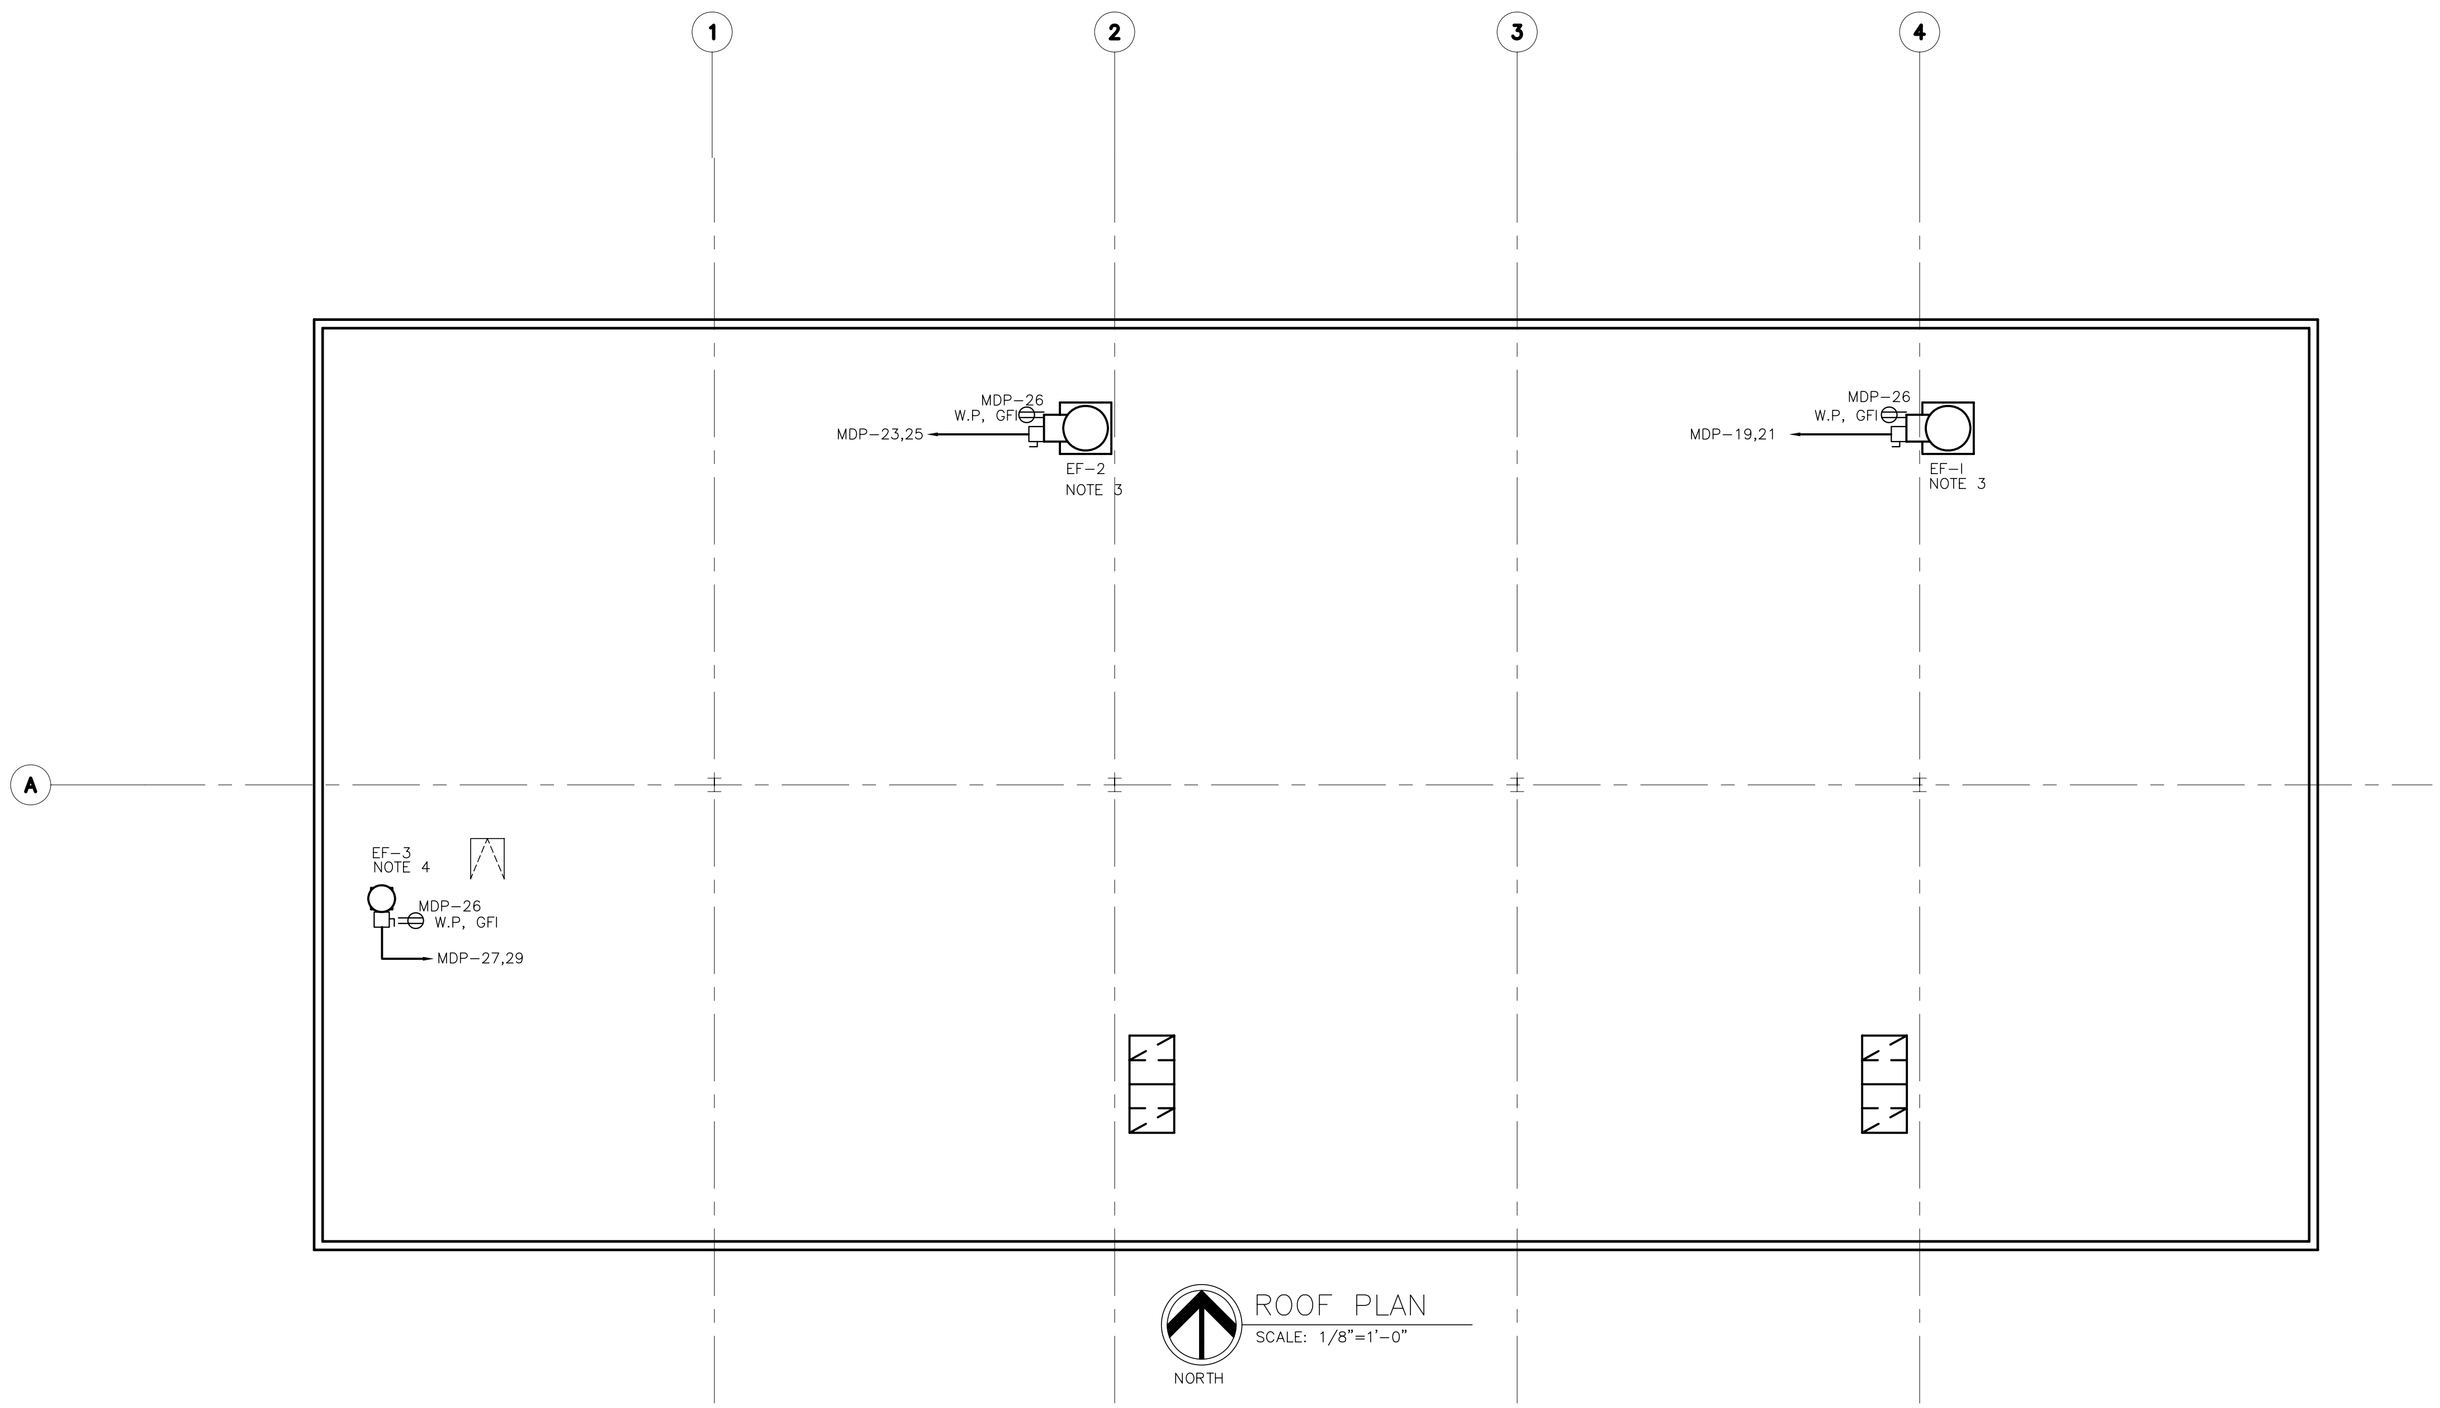

ROOF PLAN
SCALE: 1/8"=1'-0"

TRUCK & REPAIR, INC.

FES GROUP
Facility Engineering Services
28036 Oakland Oaks Ct.
Wixom, MI 48393
Phone: (248) 344-2800
Fax: (248) 344-1650
Web: www.fesgroupllc.com

Pkg.:	Issued For:	Date:
	BIDS	03-23-09
	95% OWNER REVIEW	02-01-09

Accurate Auto Carriers
Maintenance Facility

In Charge: JD
Designed: DS
Drawn: DS
Checked: JS
Approved: JS Date: 10/23/08

Sheet Title:

POWER PLAN
Roof
AREA 01

Job Number: MI-08060

Sheet Number: **E1.0.0R**